

29 June 1989

(Supersedes LO 5-6115-598-12, 17 August 1987)

**GENERATOR SET, GAS TURBINE ENGINE DRIVEN;
TACTICAL, SKID MOUNTED, 150 KW
400 HERTZ, ALTERNATING CURRENT**

Reference TM 5-6115-598-12

Approved for public release; distribution is unlimited


Intervals (on-condition or hard time) and the related man-hour times are based on normal operation. The man-hour time specified is the time you need to do all the services prescribed for a particular interval. On-condition (OC) oil sample intervals shall be applied unless changed by the Army Oil Analysis Program (AOAP) laboratory. Change the hard time interval if your lubricants are contaminated or if you are operating the equipment under adverse operating conditions, including longer-than-usual operating hours. The hard time interval may be extended during periods of low activity. If extended, adequate preservation precautions must be taken. Hard time intervals will be applied in the event AOAP laboratory support is not available.

Relubricate after washing or fording. Clean parts with dry-cleaning solvent (SD), type II or equivalent. Drain crankcase when hot, Fill and check

level. The lowest level of maintenance authorized to lubricate a point is indicated by one of the following: (C) Operator/Crew or (O) Organizational Maintenance.

Reporting errors and recommending improvements. You can help improve this manual. If you find any mistakes or if you know of a way to improve the procedures, please let us know. Mail your letter or DA Form 2028 (Recommended Changes to Publications and Blank Forms) direct to: Commander, U.S. Army Troop Support Command, ATTN: AMSTR-MCTS 4300 Goodfellow Boulevard, St. Louis, MO 63120-1798.

A reply will be furnished to you.

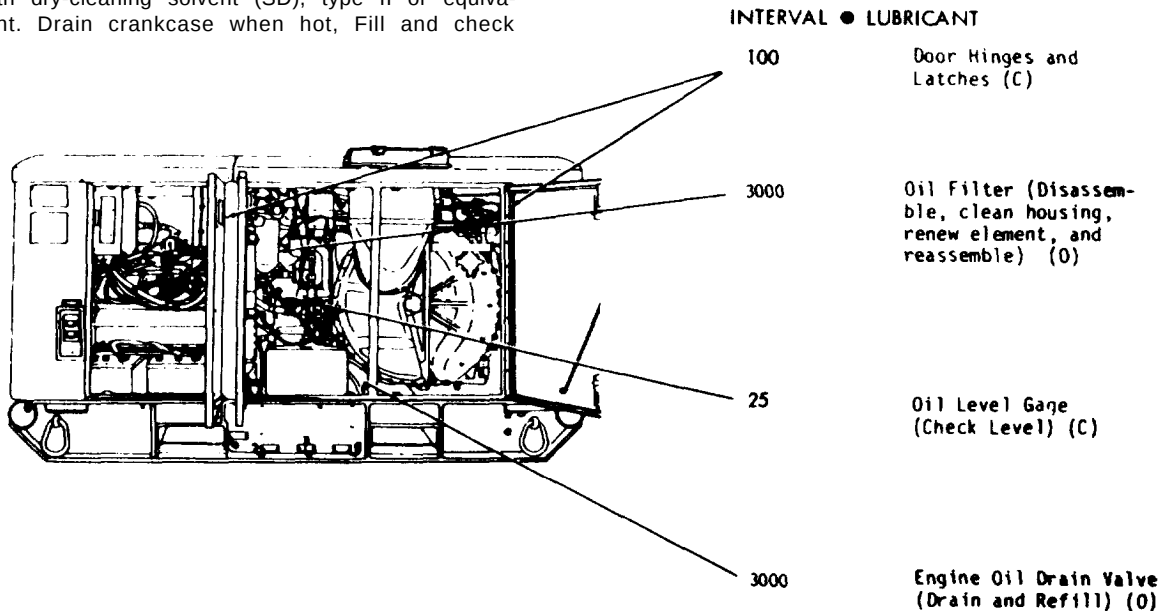

TOTAL TASK HOURS	
INTERVAL	TASK HOURS
25	0.1
100	0.3
3000	0.5