
**GENERATOR SET, DIESEL ENGINE-DRIVEN,
TACTICAL, SKID MTD, 15 KW, 3 PHASE, 4 WIRE,
120/208 AND 240/416 VOLTS
(DOD MODEL MEP-004A 6115-00-118-1241)
(DOD MODEL MEP-104A 6115-00-118-1245)
(DOD MODEL MEP-113A 6115-00-118-1244)**

References: TM 5-6115-464-12 and C9100-IL

REPORTING OF ERRORS

You can help improve this publication. If you find mistakes or if you know of a way to improve the procedures, please let us know. Your letter or DA Form 2028 (Recommended Changes to Publications and Blank Forms) should be mailed directly to: Commander, U.S. Army Troop Support Command, ATTN: AMSTR-MMTS, 4300 Goodfellow Blvd., St. Louis , MO63120- 1798. A reply will be furnished to you.

NOTES

This LO is for (C) Crew/Operator or Unit (O) maintenance. Lube intervals (on-condition or hard time) and task-hour times are based on normal hours of operation. Change the intervals if your lubricants are contaminated or if you are operating the equipment under adverse operating conditions. Lube more during constant use and less during inactive periods. Adequate preservation precautions must be taken during inactive periods.

WARNING

Dry cleaning solvent PD-680 Type II or equivalent used to clean parts is potentially dangerous to personnel and property. Avoid repeated and prolonged skin contact. Do not use near open flame or excessive heat. Flash point of solvent is 100°F - 138°F (38°C-60°C).

Clean parts with dry cleaning solvent PD-680 and dry before lubricating.

On-condition (OC) intervals for oil changes shall be determined by the Army Oil Analysis Program (AOAP) laboratory and shall be applied unless otherwise notified.

Hard time oil change intervals will be applied in the event AOAP laboratory support is not available.

Before you start your lube service:

ALWAYS

- a. Clean parts before lubricating.
- b. Use the lubrication order as your guide.

NEVER

- a. Use wrong type/grade lubricant.
- b. Use too much lubricant.

DISTRIBUTION STATEMENT A - Approved for public release; distribution is unlimited.

* The time specified is the time required to perform all services at the particular interval (on-condition or hard time).

*TOTAL TASK-HR		*TOTAL TASK-HR	
INTERVAL	TASK-HR	INTERVAL	TASK-HR
8	0.1	50H or 60D	0.6
100	0.1	1000	1.0

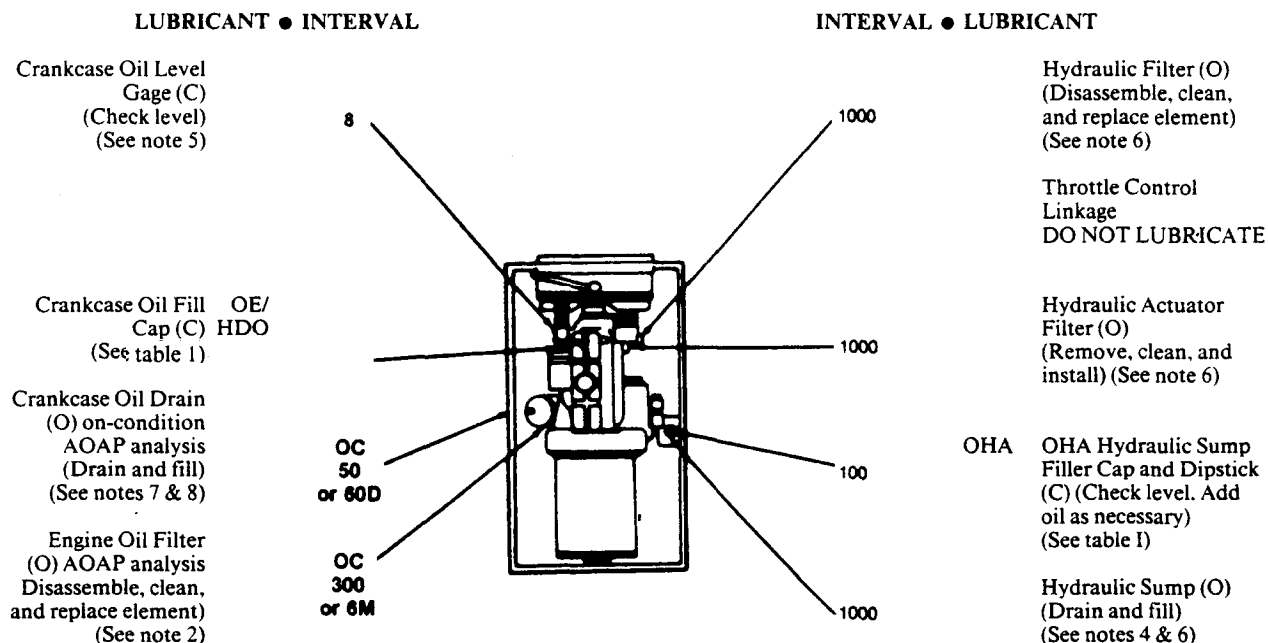


TABLE I. Lubricant Table for 15 KW Generator Set

Temperature Range	Lubricant Mil. Symbol (NATO Code) Specification	Capacity	Interval	Task-hour
-18°C to +49°C (zero to +120°F)	OE/HDO 15/40 (0-1236) MIL-L-2104	8 qts (7.6L)	300 hr	.6
-25°C to +40°C (-15°F to +40°F)	OE/HDO-10 (0-237) MIL-L-2104	8 qts (7.6L)	300 hr	.6
-10°C to +49°C (+15°F to +120°F)	OE/HDO-30 (0-238) MIL-L-2104	8 qts (7.6L)	300 hr	.6
-05°C to +49°C (+25°F to +120°F)	OE/HDO-40 (N/A) MIL-L-2104	8 qts (7.6L)	300 hr	.6
-57°C to +04°C (-70°F to +40°F)	OEA (0-183) MIL-L-46167	8 qts (7.6L)	300 hr	.6
-57°C to +49°C (-15°F to +120°F)	OEA MIL-H-4606B	4 qts (3.8L)	1000 hr	1.0