

OPERATOR'S, UNIT, AND INTERMEDIATE DIRECT SUPPORT MAINTENANCE MANUAL

5KBBL COLLAPSIBLE FABRIC TANK
NSN 5430-01-1 60-3528

50,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-455-5676
NSN 5430-00-1 82-8181

20,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-215-7525 (MODEL BA92-1 62)
20,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-359-4943 (MODEL BA91 -140)
NSN 5430-01-414-9252 (MODEL BA91 -140A)

10,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-358-6157 (MODEL BA91-141)
NSN 5430-01-414-9251 (MODEL BA91-141A)

3,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-433-8528 (MODEL WTM3KF)

GENERAL INFORMATION	1-1
---------------------	-----

EQUIPMENT DESCRIPTION AND DATA	1-3
-----------------------------------	-----

OPERATOR PMCS	2-2
---------------	-----

ASSEMBLY AND PREPARATION FOR USE	2-9
-------------------------------------	-----

UNIT MAINTENANCE	3-1
------------------	-----

MAINTENANCE ALLOCATION CHART	B-1
---------------------------------	-----

Approved for public release: Distribution is unlimited.

HEADQUARTERS, DEPARTMENT OF THE ARMY

31 AUGUST 1987

HEADQUARTERS
DEPARTMENT OF THE ARMY
WASHINGTON, D.C., 31 August 1987

**OPERATOR'S, UNIT AND INTERMEDIATE DIRECT SUPPORT
MAINTENANCE MANUAL**

5K BBL COLLAPSIBLE FABRIC TANK
NSN 5430-01-160-3528

50,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-455-5676
NSN 5430-00-182-8181

20,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-215-7525 (MODEL BA92-1 62)

20,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-359-4943 (MODEL BA91 -140)

NSN 5430-01-414-9252 (MODEL BA91 -140A)

10,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-358-6157 (MODEL BA91-141)

NSN 5430-01-414-9251 (MODEL BA91-141A)
3,000-GALLON COLLAPSIBLE FABRIC TANK
NSN 5430-01-433-8528 (MODEL WTM3KF)

REPORTING ERRORS AND RECOMMENDING IMPROVEMENTS

You can help improve this manual. If you find any mistakes or if you know of a way to improve these procedures, please let us know. Submit your DA Form 2028-2 (Recommended Changes to Equipment Technical Publications), through the Internet, on the Army Electronic Product Support (AEPS) website. The internet address is <http://aeprs.ria.army.mil>. If you need a password, scroll down and click on "ACCESS REQUEST FORM". The DA Form 2028 is located in the ONLINE FORMS PROCESSING section of the AEPS. Fill out the form and click on SUBMIT. Using this form on the AEPS will enable us to respond quicker to your comments and better manage the DA Form 2028 program. You may also mail, fax or email your letter, DA Form 2028, or DA Form 2028-2 direct to: Commander, US Army, Tank-automotive and Armaments Command, ATTN: AMSTA-AC-NML, Rock Island, IL 61299-7630. The email address is amsta-ac-nml@ria.army.mil. The fax number is DSN 793-0726 or Commercial (309) 782-0726.

DISTRIBUTION STATEMENT A: Approved for public release; distribution is unlimited.

TABLE OF CONTENTS

	PAGE
INTRODUCTION.....	1-1
Section I General Information.....	1-1
Section II Equipment Description.....	1-3
Section III Principles of Operation.....	1-6.2

CHAPTER 2 OPERATING INSTRUCTIONS.....	2-1
Section I Description and Use of Operator's Controls and Indicators	2-1
Section II General Information	2-2
Section III Operation Under Usual Conditions	2-9
Section IV Operation Under Unusual Conditions	2-23
Section V Operator Maintenance	2-24
CHAPTER 3 UNIT MAINTENANCE.....	3-1
Section I Lubrication Instructions.....	3-1
Section II Repair Parts; Special Tools; Test, Measurement and Diagnostic Equipment (TMDE); and Support Equipment.....	3-1
Section III Service Upon Receipt	3-1
Section IV Preventive Maintenance Checks and Services (PMCS).....	3-2
Section V Troubleshooting Procedures	3-6
Section VI Maintenance Procedures.....	3-16
Section VII Preparation for Storage and Shipment.....	3-41
CHAPTER 4 INTERMEDIATE DIRECT SUPPORT MAINTENANCE.....	4-1
APPENDIX A REFERENCES	A-1
APPENDIX B MAINTENANCE AND ALLOCATION CHART.....	B-1
Section I Introduction	B-1
Section II Maintenance and Allocation Chart for 3,000-Gallon, 10,000-Gallon, 20,000-Gallon, or 50,000-Gallon Collapsible Fabric Tank.....	B-5
Section III Tool and Test Equipment Requirements for 3,000-Gallon, 10,000-Gallon, 20,000-Gallon, or 50,000-Gallon Collapsible Fabric Tank.....	B-7
Section IV Remarks	B-7
APPENDIX C COMPONENTS OF END ITEM AND BASIC ISSUE ITEMS LISTS..	C-1
Section I Introduction	c-1
Section II Components of End Item.....	c-2
Section III Basic Issue Items	C-6
APPENDIX D ADDITIONAL AUTHORIZATION LIST (AAL) ITEMS (not applicable).....	D-1
APPENDIX E EXPENDABLE/DURABLE SUPPLIES AND MATERIALS LIST.....	E-1
Section I Introduction	E-1
Section II Components of End Item.....	E-2
APPENDIX F REPAIR PARTS AND SPECIAL TOOLS LIST (not applicable).	F-1
APPENDIX G TORQUE LIMITS	G-1
GLOSSARY	Glossary 1
INDEX	Index 1

CHAPTER 1 INTRODUCTION

Section I. GENERAL INFORMATION

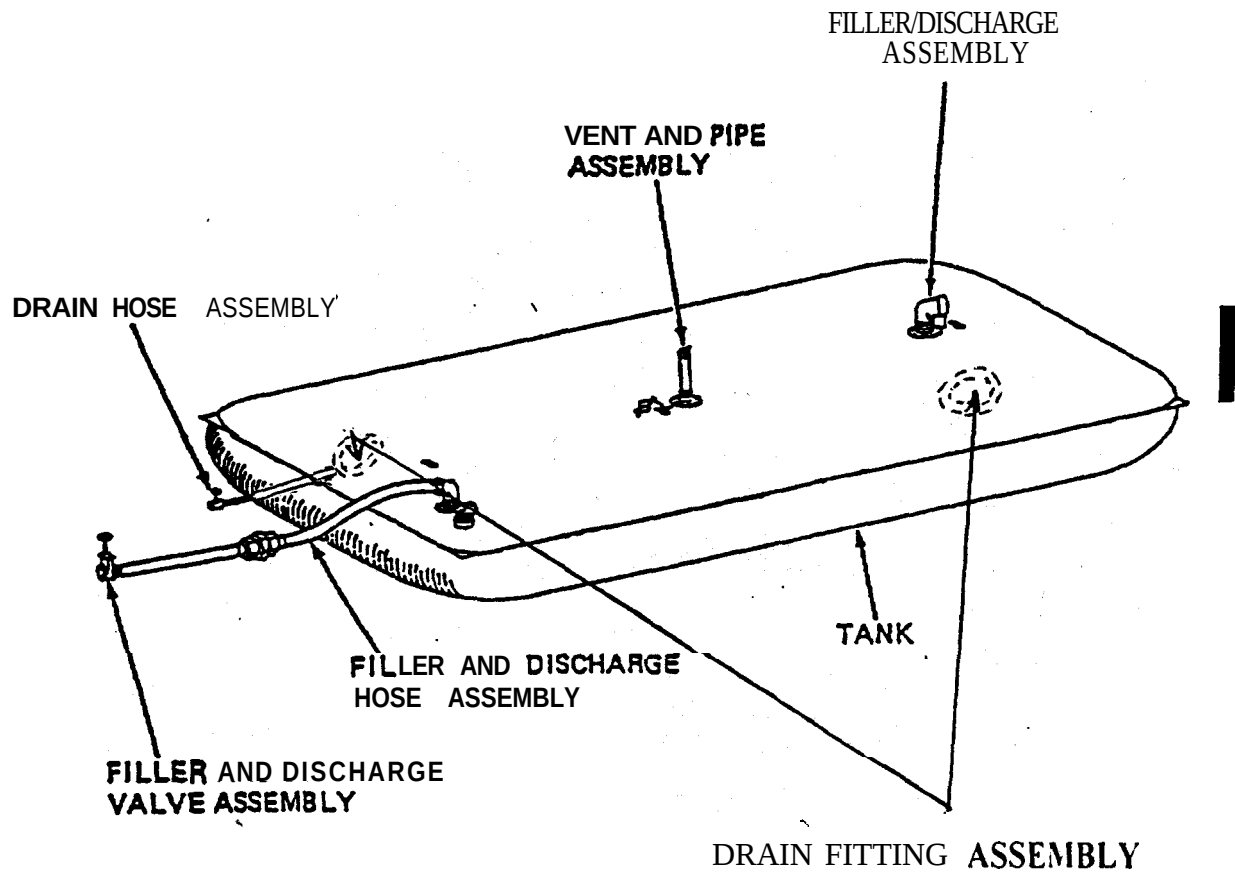


Figure 1-1 3,000-Gallon, 10,000-Gallon, 20,000-Gallon, or 50,000-Gallon Collapsible Fabric Tank, typical.

1-1. SCOPE.

1-1.1 ~~Type of Manual~~. unit, and intermediate **direct** support maintenance manual.

1-1.2 Equipment Name ~~3,000-Gallon, 10,000-Gallon, 20,000-Gallon, or 50,000-Gallon~~
Collapsible Fabric Tank..

1-1.3 Purpose of Equipment. The ~~3,000-Gallon 10,000-Gallon, 20,000-Gallon, 50,000-Gallon~~
Collapsible Fabric Tank is a container designed to store a variety of petroleum liquids. The tank
will be used to store fuel as part of a bulk fuel terminal. Fuel will be available for use in a **quick-**
response deployment operation.

1-1.4 Special Limitations on Equipment. The tank is made of tough polymer-coated nylon fabric.
Care must be taken not to puncture or tear the material.

1-2. MAINTENANCE FORMS, RECORDS, AND REPORTS.

Department of the Army forms used for equipment maintenance will be those prescribed
by DA Pam 738-750, the Army Maintenance Management System (**TAMMS**).

1-3. DESTRUCTION OF ARMY MATERIAL TO-PREVENT ENEMY USE.

Refer to TM 750-244-3, Procedures for Destruction of Equipment to Prevent Enemy Use,
for destruction of this equipment.

1-4. PREPARATION FOR STORAGE OR SHIPMENT.

Refer to paragraph 3-2 1 for storage preparation or shipment procedures.

1-5 HAND RECEIPT (-HR) MANUALS

This paragraph has been deleted.