

TM 10-5430-240-13&P

TECHNICAL MANUAL

OPERATOR, UNIT, AND DIRECT SUPPORT MAINTENANCE MANUAL (INCLUDING REPAIR PARTS AND SPECIAL TOOLS LIST)


TANK, FABRIC, COLLAPSIBLE, WATER, 3,000 AND 5,000 GALLONS, SEMI-TRAILER MOUNTED

3,000 GALLONS

MODEL PD62783-3000	(EIC = ZJP)	NSN 5430-01-181-4071
MODEL 91093	(EIC = ZFX)	NSN 5430-01-372-6901

5,000 GALLONS

MODEL PD62783-4750	(EIC = ZJJ)	NSN 5430-01-120-7823
MODEL 91094	(EIC = ZFY)	NSN 5430-01-372-6900

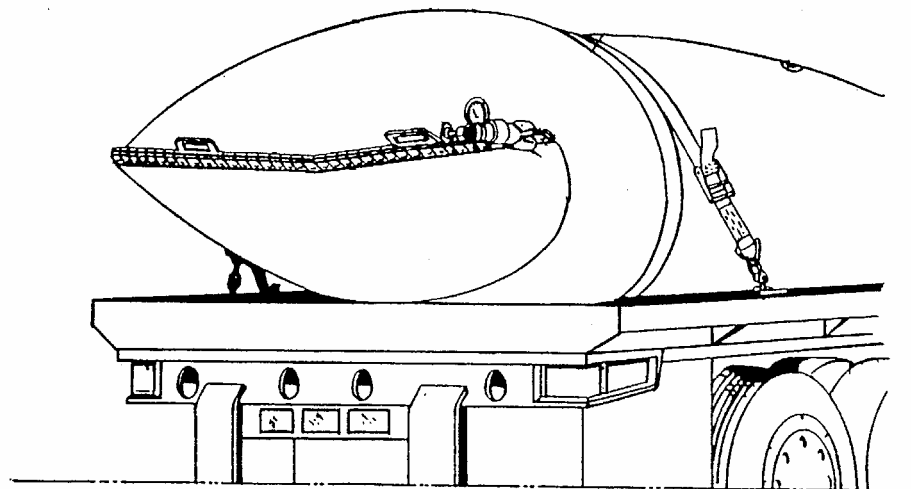

This manual supersedes TM 5-5430-212-13&P dated 15 September 1986 and TM 5-5430-213-13&P, dated 27 October 1986, including all changes.

DISTRIBUTION STATEMENT A: Approved for public release; distribution is unlimited

HEADQUARTERS, DEPARTMENT OF THE ARMY

FEBRUARY 2002

HEADQUARTERS
DEPARTMENT OF THE ARMY
WASHINGTON, D.C., 5 February 2002

TECHNICAL MANUAL

OPERATOR, UNIT, AND DIRECT SUPPORT MAINTENANCE MANUAL (Including Repair Parts and Special Tools List)

TANK, FABRIC, COLLAPSIBLE, WATER, 3,000 AND 5,000 GALLONS, SEMI-TRAILER MOUNTED

3,000 GALLON

MODEL PD62783-3000 (EIC = ZJP) NSN 5430-01-181-4071
MODEL 91093 (EIC = ZFX) NSN 5430-01-372-6901

5,000 GALLON

MODEL PD62783-4750 (EIC = ZJJ) NSN 5430-01-120-7823
MODEL 91094 (EIC = ZFY) NSN 5430-01-372-6900

Current as of 30 August 2001

REPORTING ERRORS AND RECOMMENDING IMPROVEMENTS

You can help improve this publication. If you find any mistakes or if you know of a way to improve the procedures, please let us know. Submit your DA Form 2028 (Recommended Changes to Publications and Blank Forms), through the Internet, on the Army Electronic Product Support (AEPS) website. The Internet address is <http://aeeps.ria.army.mil>. If you need a password, scroll down and click on "ACCESS REQUEST FORM". The DA Form 2028 is located in the ONLINE FORMS PROCESSING section of the AEPS. Fill out the form and click on SUBMIT. Using this form on the AEPS will enable us to respond quicker to your comments and better manage the DA Form 2028 program. You may also mail, fax or email your letter, or DA Form 2028 direct to: AMSTA-LC-CI/TECH PUBS, TACOM-RI, 1 Rock Island Arsenal, Rock Island, IL 61299-7630. The email address is TACOM-TECH-PUBS@ria.army.mil. The fax number is DSN 793-0726 or Commercial (309) 782-0726

This manual supersedes TM 5-5430-212-13&P, dated 15 September 1986, and TM 5-5430-213-13&P dated 27 October 1986, including all changes.

DISTRIBUTION STATEMENT A – Approved for public release; distribution is unlimited.

TABLE OF CONTENTS

WP Sequence No.

WARNING SUMMARY

HOW TO USE THIS MANUAL

General Information	0001 00
CHAPTER 1- Description and Theory of Operation	
Equipment Description and Data	0002 00
Theory of Operation	0003 00
CHAPTER 2- Operator Instructions	
Description and Use of Operator Controls and Indicators	0004 00
Operation Under Usual Conditions	0005 00
Operation Under Unusual Conditions	0006 00
CHAPTER 3- Troubleshooting Procedures	
Operator Troubleshooting Procedures.....	0007 00
Unit Troubleshooting Procedures	0008 00
Direct Support Troubleshooting Procedures.....	0009 00
CHAPTER 4- Operator Maintenance Instructions	
PMCS Procedures Introduction	0010 00
Operator Maintenance Procedures.....	0011 00
CHAPTER 5- Unit Maintenance Instructions	
Lubrication Instructions	0012 00
Unit Repair; Tools; Special Tools; Test, Measurement, and Diagnostic Equipment (TMDE); and Support Equipment.....	0013 00
Unit Service Upon Receipt.....	0014 00
PMCS Procedures Introduction	0015 00
Unit Maintenance Procedures.....	0016 00
Tank Assembly Inspection, Repair and Replacement.....	0017 00
Clamp Assembly Inspection, Repair and Replacement.....	0018 00
Filler/Discharge Assembly Inspection, Repair and Replacement.....	0019 00
Hand Grip Assembly Inspection and Replacement.....	0020 00
Tie-down Assembly Inspection and Replacement.....	0021 00
Preparation for Storage or Shipment	0022 00
CHAPTER 6- Direct Support Maintenance Instructions	
Direct Support Repair; Tools; Special Tools; Test, Measurement and Diagnostic Equipment (TMDE); and Support Equipment	0023 00
Direct Support Maintenance Procedures	0024 00
Hydrostatic Test	0025 00
CHAPTER 7- Supporting Information	
References.....	0026 00
Maintenance Allocation Chart.....	0027 00
Repair Parts Introduction	0028 00
Repair Parts List.....	0029 00
National Stock Number Index	0030 00

Part Number Index	0031 00
Components of End Item (COEI) and Basic Issue Items (BII) Lists	0032 00
Additional Authorization List.....	0033 00
Expendable and Durable Items List	0034 00
Torque Limits	0035 00
Mandatory Replacement Parts List.....	0036 00

GLOSSARY

INDEX

HOW TO USE THIS MANUAL

Section I. OVERVIEW -This manual is divided into seven chapters consisting of 36 work packages that provide all the information necessary to operate and maintain the collapsible fabric water tank assemblies.

Section II. INDEXING -This manual contains several types of indexes to help the user locate information quickly and efficiently. The different indexes are as follows:

a. Table of Contents. Lists all chapters and work packages contained in the manual, along with the work package numbers where they begin.

b. Alphabetical Index. Located at the back of the manual, this index lists entries that personnel are most likely to look for. Most listings are provided several times in the index (i.e., "Maintenance Forms and Records" can also be found as "Forms and Records, Maintenance," and "Records, Maintenance Forms and"). This increases the likelihood of finding the information the first place you look. Each entry also lists the work package where the information can be found.

**OPERATOR, UNIT, AND DIRECT SUPPORT MAINTENANCE MANUAL
(INCLUDING REPAIR PARTS AND SPECIAL TOOLS LIST)
TANK, FABRIC, COLLAPSIBLE, WATER, 3,000 AND 5,000 GALLON, SEMI-TRAILER MOUNTED
GENERAL INFORMATION**

SCOPE

This technical manual contains instructions for operations, checks and corrective maintenance procedures for the 3,000 and 5,000 Gallon Collapsible Fabric Semi-Trailer Mounted Water Tanks.

Type of Manual: Operator, Unit, and Direct Support Maintenance.

Model Number and Equipment Names: PD62783-3000 and 91093 for the 3,000 gallon tanks, PD62783-4750 and 91094 for the 5,000 gallon Fabric Collapsible Potable Water Semi-Trailer Mounted Tanks.

Purpose of Equipment: The 3,000 and 5,000 gallon collapsible fabric water tanks are utilized with the M127, M871, and the M872 semi-trailers (3,000 gallon tanks), or the M872 (5,000 gallon tank), to store and distribute potable drinking water.

MAINTENANCE FORMS, RECORDS, AND REPORTS

Department of the Army forms and procedures used for equipment maintenance will be those prescribed by (as applicable) DA PAM 738-750, Functional Users Manual for The Army Maintenance Management System (TAMMS); DA PAM 738-751, Functional Users Manual for The Army Maintenance Management System Aviation (TAMMS-A); or AR 700-138, Army Logistics Readiness and Sustainability.

CORROSION PREVENTION AND CONTROL (CPC)

Corrosion Prevention and Control (CPC) of Army materiel is a continuing concern. It is important that any corrosion problems with this item be reported so that the problem can be corrected and improvements can be made to prevent the problem in future items.

While corrosion is typically associated with rusting of metals, it can also include deterioration of other materials, such as rubber and plastic. Unusual cracking, softening, swelling, or breaking of these materials may be a corrosion problem.

If a corrosion problem is identified, it can be reported using SF 368, Product Quality Deficiency Report. Use of key words such as "rust," "deterioration," "corrosion," or "cracking" will ensure that the information is identified as a CPC problem.

The form should be submitted to the address specified in DA Pam 738-750, Functional Users Manual for the Army Maintenance Management System (TAMMS).

DESTRUCTION OF ARMY MATERIEL TO PREVENT ENEMY USE

Command decisions, according to tactical situations, will determine when destruction of the collapsible fabric water tank assembly will be accomplished. A destruction plan will be prepared by the using organization, unless higher authority has prepared one. For general destruction procedures for this equipment, refer to TM 750-244-3, Procedures for Destruction of Equipment to Prevent Enemy Use.

REPORTING EQUIPMENT IMPROVEMENT RECOMMENDATIONS (EIRs)

If the collapsible fabric water tank assembly needs improvement, let us know. Send us an EIR. You, the user, are the only one who can tell us what you don't like about your equipment. Let us know why you don't like the design or performance. Put it on an SF 368 (Product Quality Deficiency Report). Mail it to us at Commander, U.S. Army Tank-automotive and Armaments Command, ATTN: AMSTA-LC-CIP-WT, Rock Island, IL 61299-7630. We will send you a reply

PREPARATION FOR STORAGE OR SHIPMENT

Refer to Work Package 0022 00.

QUALITY ASSURANCE/QUALITY CONTROL (QA/QC)

Workmanship shall be of the highest quality and shall permit no defects not repaired in accordance with the instructions in this manual. All metal parts shall be clean and free of sand, dirt, etc. The inside and outside of the tank shall be clean and free of foreign material.

END OF WORK PACKAGE

CHAPTER 1

DESCRIPTION AND THEORY OF OPERATION
FOR
TANK, FABRIC, COLLAPSIBLE, WATER, 3,000 AND 5,000 GALLONS,
SEMI-TRAILER MOUNTED

**OPERATOR, UNIT, AND DIRECT SUPPORT MAINTENANCE MANUAL
(INCLUDING REPAIR PARTS AND SPECIAL TOOLS LIST)
TANK, FABRIC, COLLAPSIBLE, 3,000 AND 5,000 GALLONS, SEMI-TRAILER MOUNTED
EQUIPMENT DESCRIPTION AND DATA**

EQUIPMENT CHARACTERISTICS, CAPABILITIES, AND FEATURES

Characteristics, capabilities, and features of the collapsible fabric semi-trailer mounted water tank assemblies include:

- a. The tank is constructed of a chlorobutyl material (a rubber coated multi-ply carcass).
- b. The tank is designed to store and transport potable water.
- c. Pull handles are provided to facilitate positioning the tank while empty.
- d. When not in use, the tank may be folded or rolled, and stored in the sling and shipping container.

DIFFERENCES BETWEEN MODELS

The models are similar except for variations in size and capacity.

LOCATION AND DESCRIPTION OF MAJOR COMPONENTS

Refer to Work Package 0004 00 for locations.

EQUIPMENT DATA

CAUTION

If the tank is used in temperatures below freezing (32°F (0°C)), caution must be used to prevent water in the tank, or in contact with metal parts, from freezing. If water freezes, damage may occur to the tank and/or metal parts.

OPERATING TEMPERATURE (AMBIENT)

LOW -25°F (-31.70°C)
HIGH 160°F (71.1°C)

STORAGE TEMPERATURE (AMBIENT)

LOW -25°F (-31.70°C)
HIGH 160°F (71.1°C)

SPECIFICATIONS, MODEL PD62783-3000

MANUFACTURER Uniroyal, Warsaw, Indiana
NSN 5430-01-181-4071
DRY DIMENSIONS 28'L X 7'4"W X 4'H (8.5m x 2.2m x 1.2m)
HEIGHT (FILLED) 54 inches (137.2cm)
WIDTH 62 inches (157.5cm)
LENGTH 27 feet (8.2m) (Approx.)
WEIGHT (Empty) 600 pounds (272.4kg) (Approx.)
CAPACITY 3,000 gallons (11,355L)

SPECIFICATIONS, MODEL 91093

MANUFACTURER Amfuel, Magnolia, Arkansas
NSN 5430-01-372-6901
DRY DIMENSIONS 28'L X 7'4"W X 4'H (8.5m x 2.2m x 1.2m)
HEIGHT (FILLED) 54 inches (137.2cm)
WIDTH 62 inches (157.5cm)

LENGTH.....	27 feet (8.2m) (Approx.)
WEIGHT (Empty)	600 pounds (272.4kg) (Approx.)
CAPACITY	3,000 gallons (11,355L)
SPECIFICATIONS, MODEL PD62783-4750	
MANUFACTURER	Uniroyal, Warsaw, Indiana
NSN.....	5430-01-120-7823
DRY DIMENSIONS.....	39'L X 7'4"W X 4'4"H (11.9m x 2.2m x 1.3m)
HEIGHT (FILLED).....	54 inches (137.2cm)
WIDTH.....	62 inches (157.5cm)
LENGTH.....	38 feet (11.6m)
WEIGHT (Empty)	825 pounds (375kg)
CAPACITY	4,750 gallons (17,979L)
SPECIFICATIONS, MODEL 91094	
MANUFACTURER	Amfuel, Magnolia, Arkansas
NSN.....	5430-01-372-6900
DRY DIMENSIONS.....	39'L X 7'4"W X 4'4"H (11.9m x 2.2m x 1.3m)
HEIGHT (FILLED).....	54 inches (137.2cm)
WIDTH.....	62 inches (157.5cm)
LENGTH.....	38 feet (11.6m)
WEIGHT (Empty)	825 pounds (375kg)
CAPACITY	4,600 gallons (17,411L)

INFORMATION DATA PLATE

The following information shall be located on the tank for models 91093 and 91094:

TORQUE 70 ± 5 IN. LBS
 DRINKING WATER
 TRANSPORT ONLY WHEN COMPLETELY FULL OR EMPTY
 REMOVE GAGE WHEN TRANSPORTING
 OPERATING PRESSURE 5 ± 1 PSIG
 TIE-DOWN STRAP LOCATIONS

The following information shall be located on the tank for models PD62783-3000 and PD62783-4750:

TORQUE 70 ± 5 IN. LBS
 POTABLE WATER
 TRANSPORT ONLY WHEN COMPLETELY FULL OR EMPTY
 OPERATING PRESSURE 5 ± 1 PSIG
 TIE-DOWN STRAP LOCATIONS

FITTINGS


The tank is furnished with a four-inch filler/discharge assembly consisting of a male quick-disconnect, a four-inch gate valve, and a pressure gage, two 10-foot lengths of hose, and a manually operated relief valve located in the top center of the tank.

TIE-DOWN ASSEMBLY


The tie-down kit consists of four belts with eight ratchet take-up mechanisms, and trailer attachments specifically designed to minimize tank movement during transport.

EMERGENCY REPAIR ITEMS


The emergency repair kit includes temporary repair items, such as plugs and clamps, to accomplish an emergency repair.

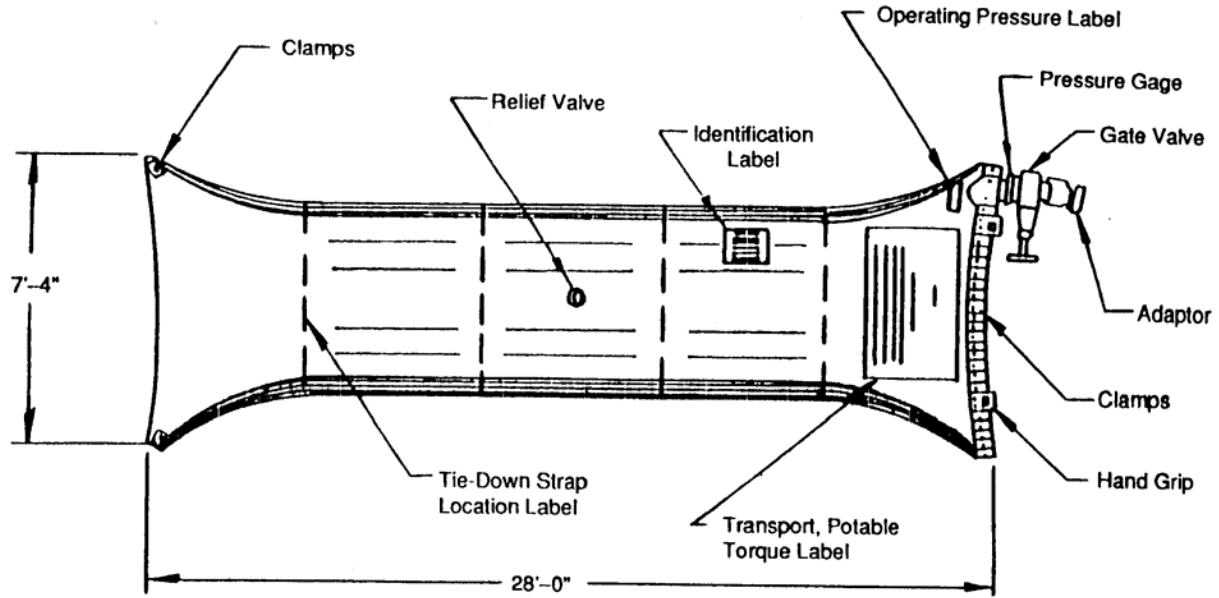


3,000 Gallon Potable Water Tank (Model PD62783-3000)

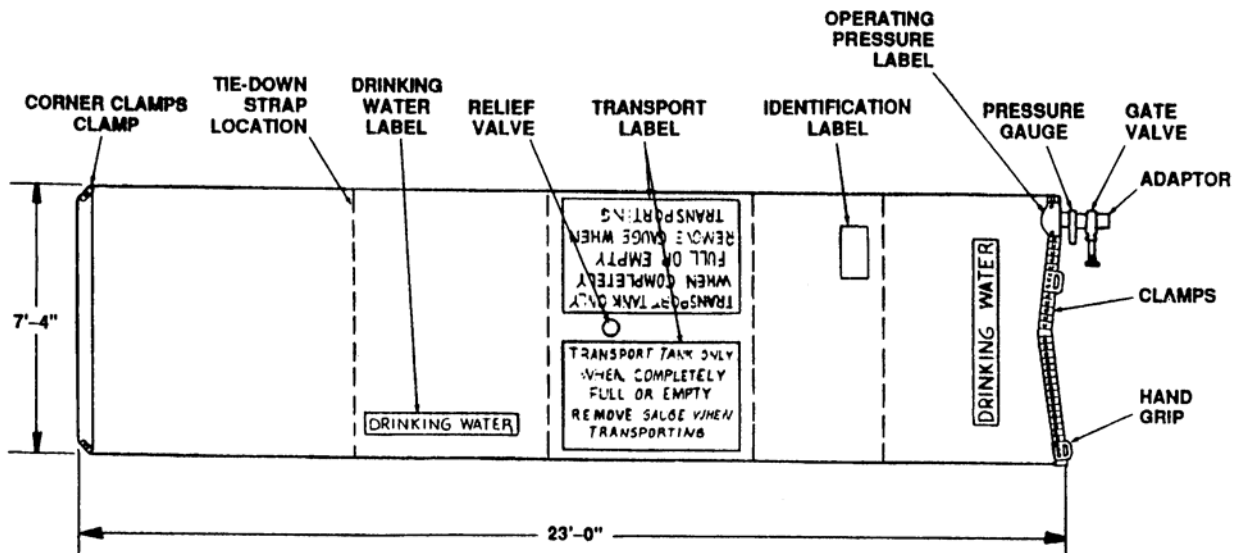

3,000 Gallon Potable Water Tank (Model 91093)

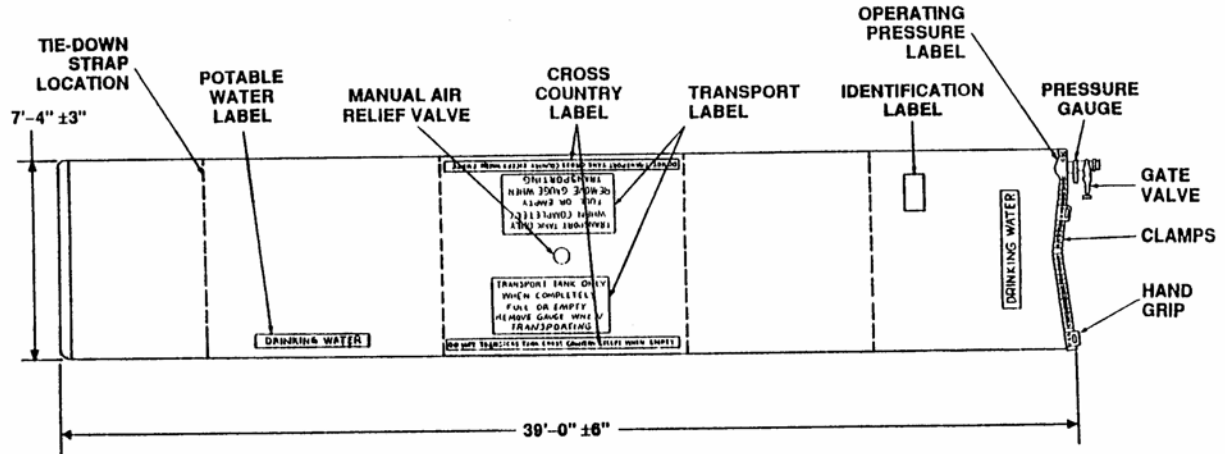

**4,600 Gallon Potable Water Tank (Model 91094)
Semi-Trailer Mounted**

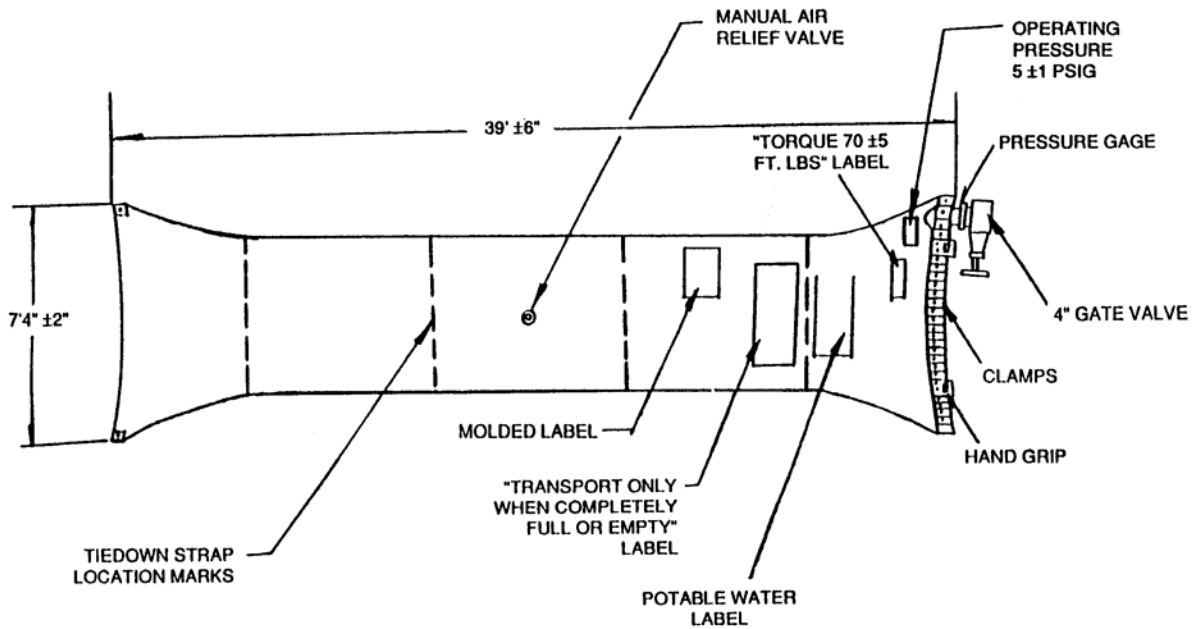

**4,750 Gallon Potable Water Tank Model (PD62783-4750)
Semi-Trailer Mounted**

END OF WORK PACKAGE